



******* Company
Chiba Factory
DC Power Supply
Diagnosis Report**

15-Jun-10

Approved by

B-BEST Co.,Ltd.

DC Power Supply

Company name	***** Company	
Office name	Chiba Factory	
Customer name		
Storage battery type	AHH40x80	YUASA
Manufacturing years	Dec-95	
Inspected day	15-Jun-10	
Use years	14 years 6 months	
Inspected by	B-BEST Co.,Ltd.	Maeda, Taniguchi
Instrument model & number	BEST600mx2	G03AX-180

Diagnosis result

Inspected total cells	80	cells	
Normal cells	80	cells	(100.0%)
Cells: 50% Capacity < 80%	0	cells	(0.0%)
Cells: Capacity < 50%	0	cells	(0.0%)

Normal cells	discharge Voltage at 500mS	1.23 V
Cells: 50% Capacity < 80%	1.18 V discharge voltage	< 1.23 V
Cells: Capacity < 50%	discharge Voltage at 500mS	< 1.18 V

1) Float voltage

2) Discharge voltage

3) Recovery voltage

4) Internal resistance


5) Others

***** Company
Chiba Factory

Storage battery type AHH40x80
Manufacturing years 1-Dec-95
Discharge current 40 A

Inspected day 15-Jun-10


Terminal Voltage of cells

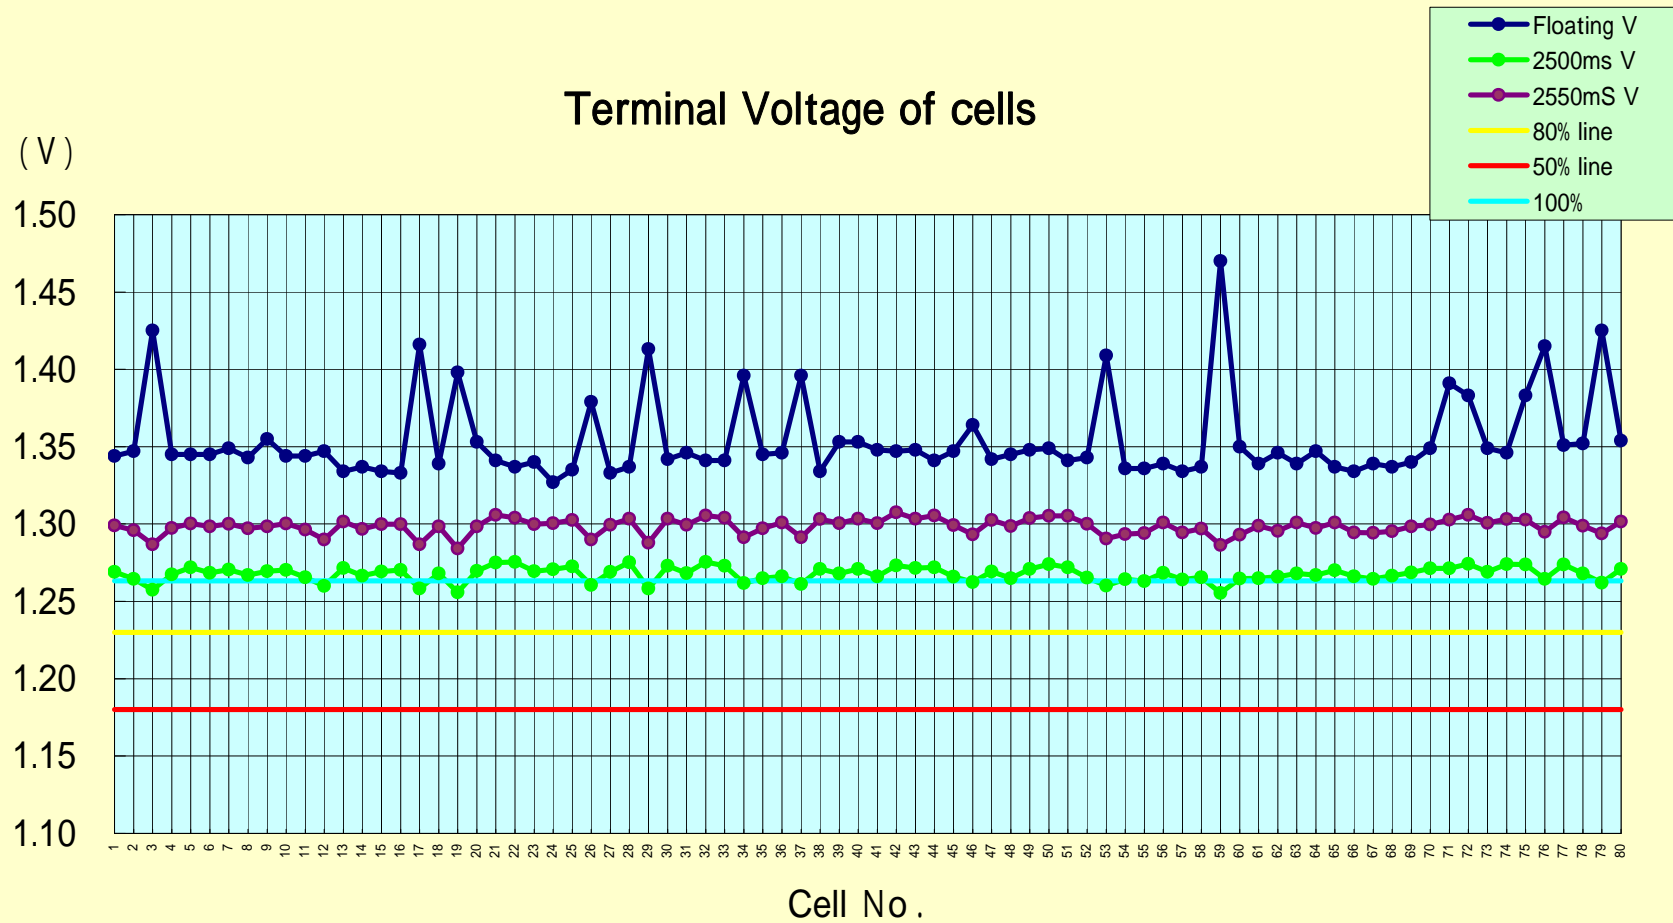

***** Company
Chiba Factory

Storage battery type AHH40x80
Manufacturing years 1-Dec-95
Discharge current 40 A


Inspected day 15-Jun-10

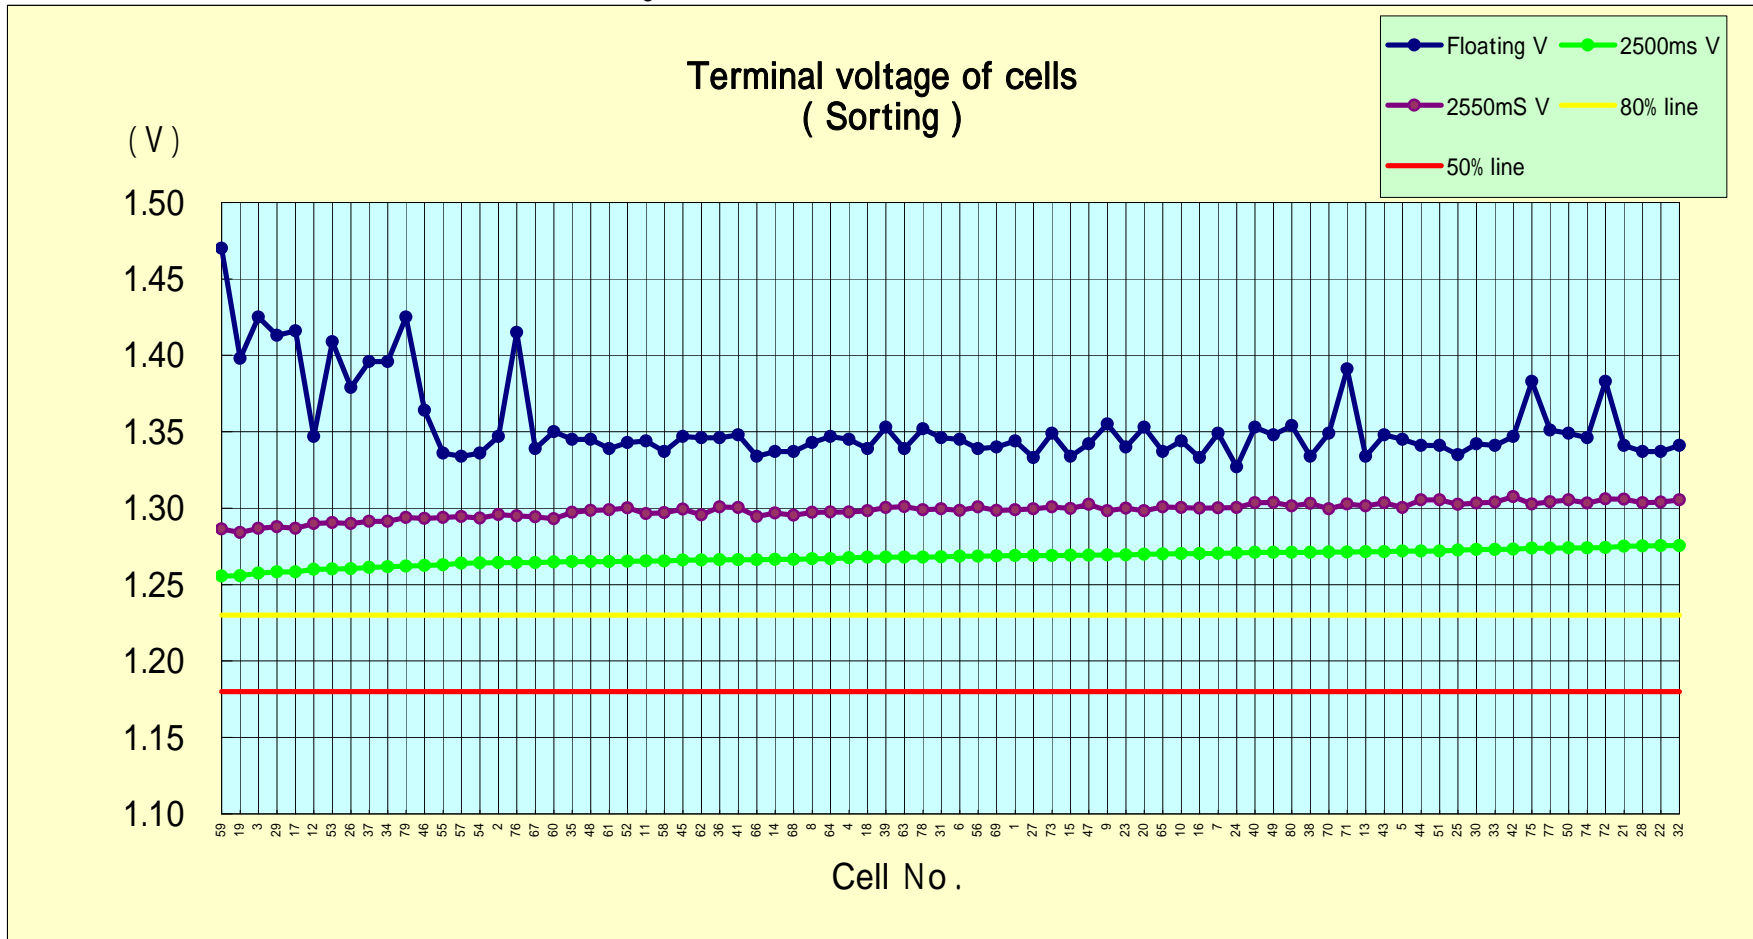

***** Company
Chiba Factory

Storage battery type AHH40x80
Manufacturing years 1-Dec-95
Discharge current 40 A


Inspected day

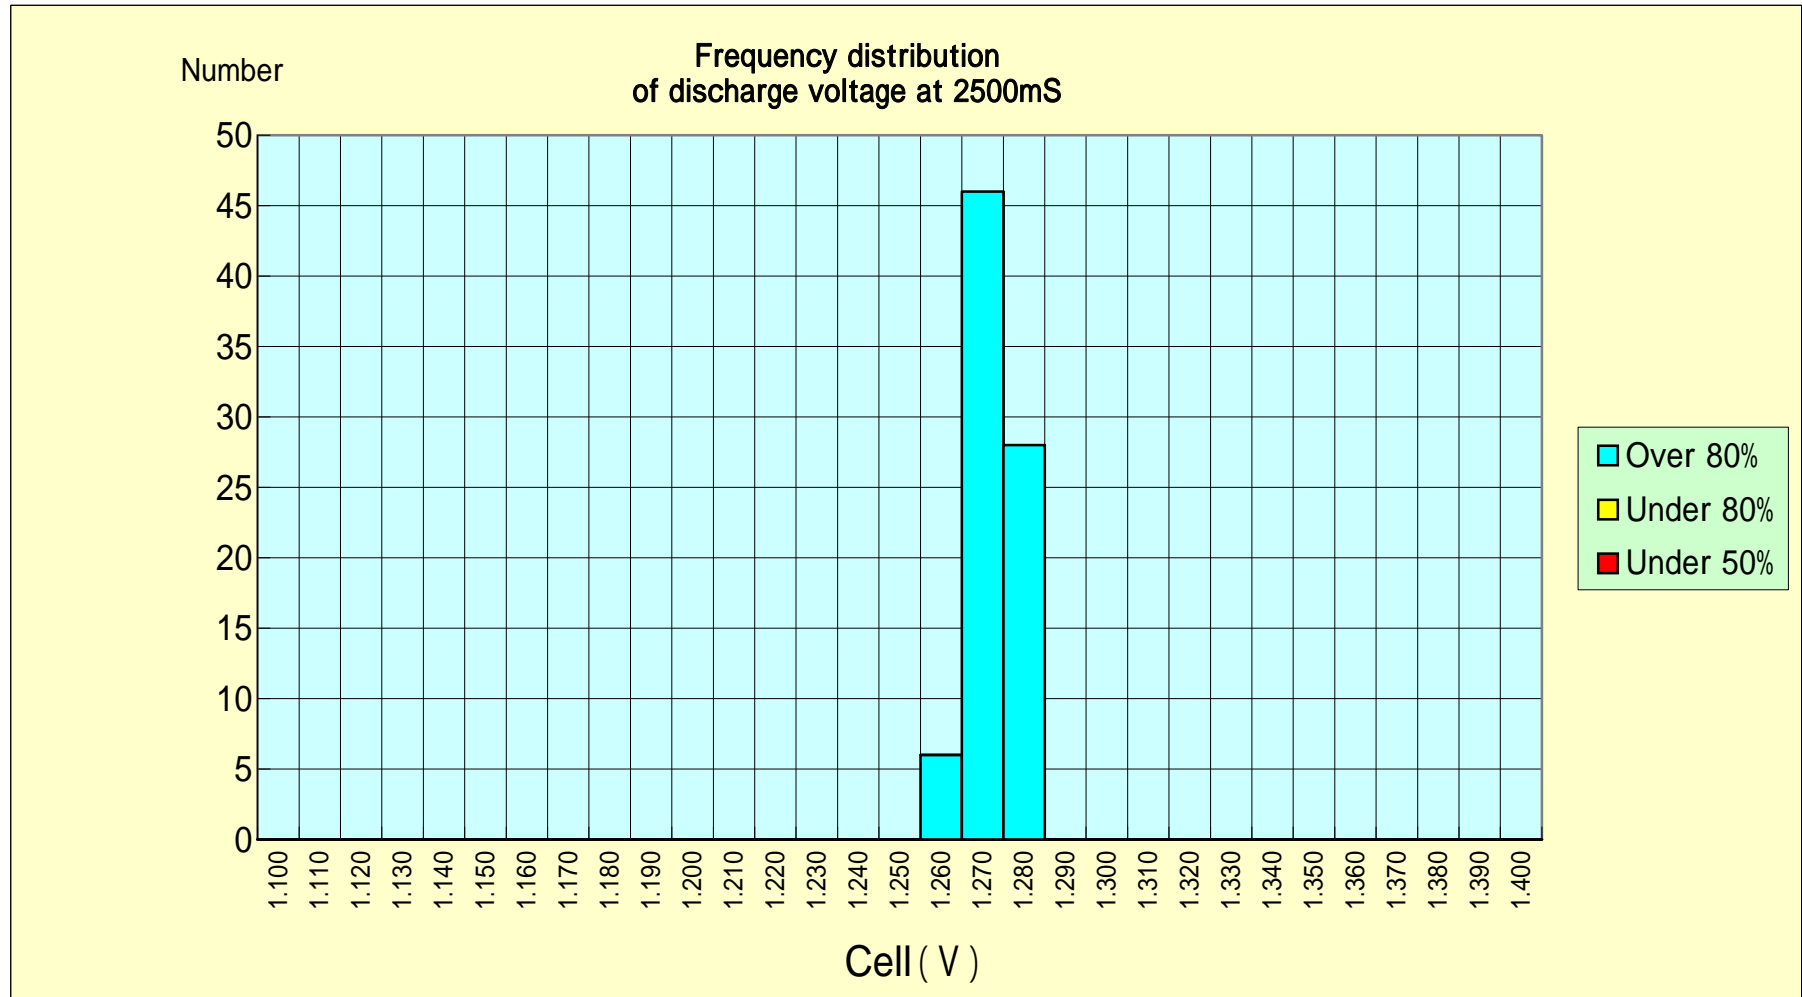

***** Company
Chiba Factory

Storage battery type AHH40x80
Manufacturing years 1-Dec-95
Discharge current 40 A

Inspected day 15-Jun-10






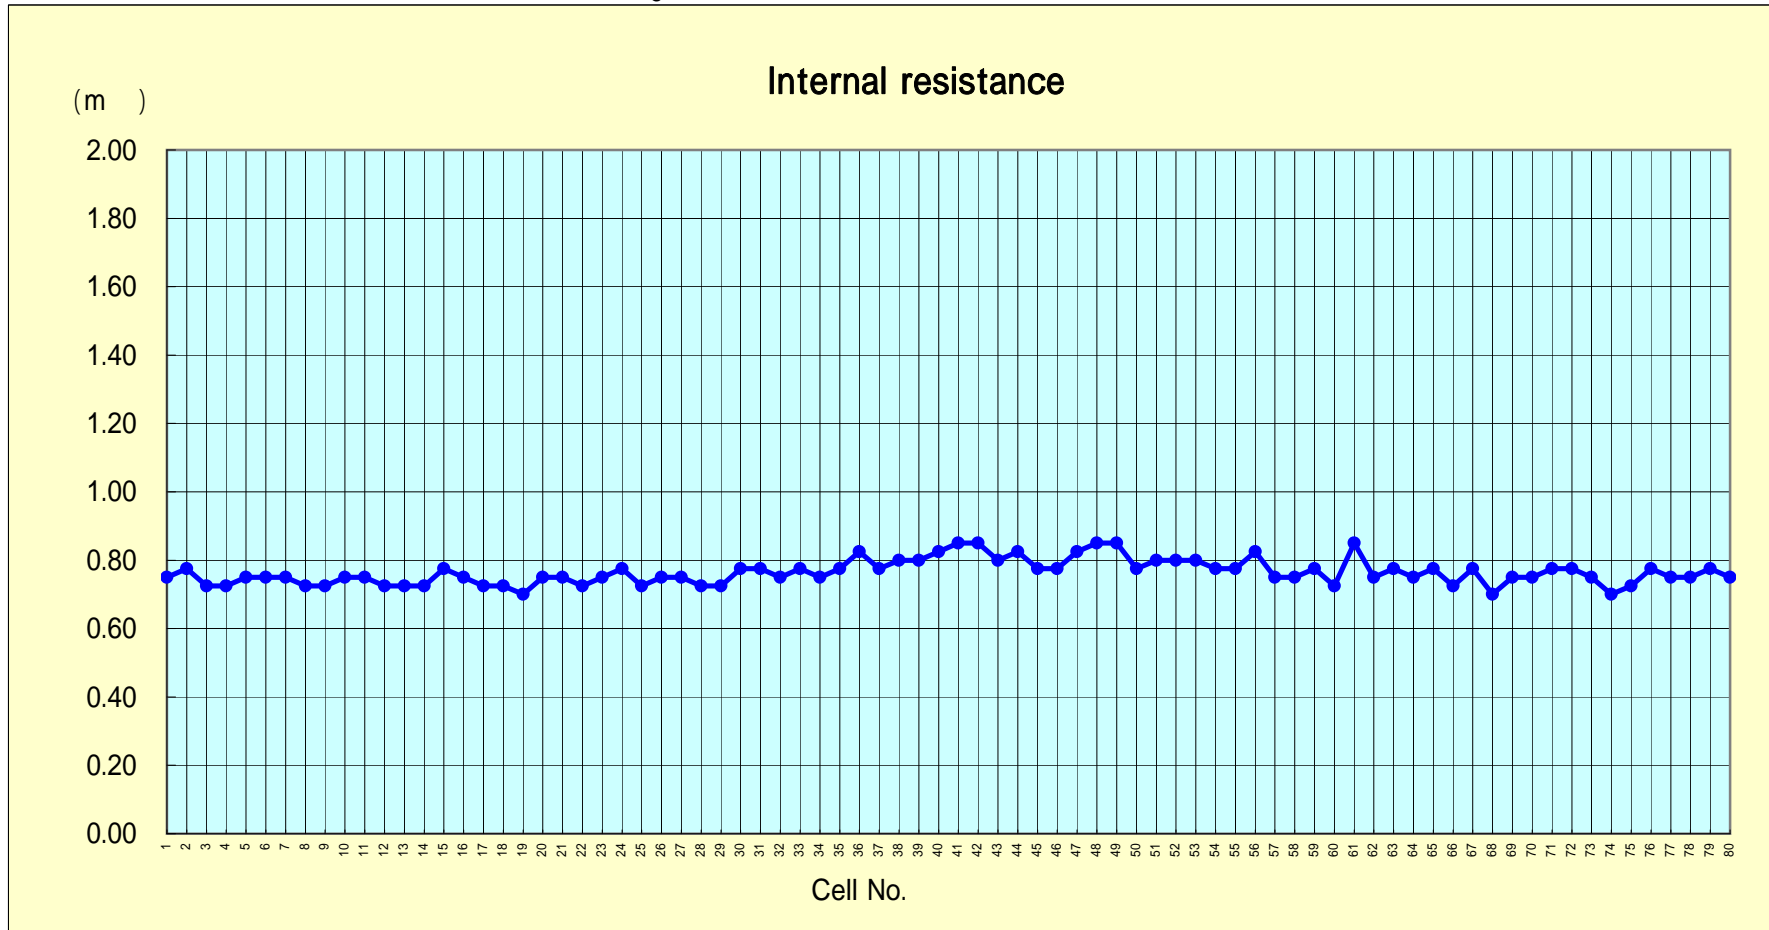


***** Company
Chiba Factory

Storage battery type
Manufacturing years
Discharge current

AHH40x80
1-Dec-95
40 A

Inspected day
15-Jun-10

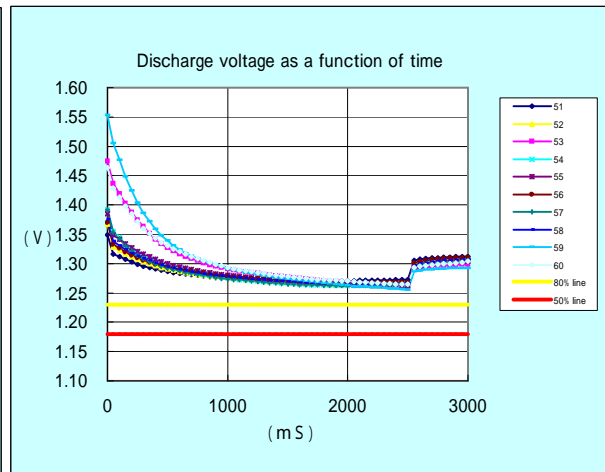
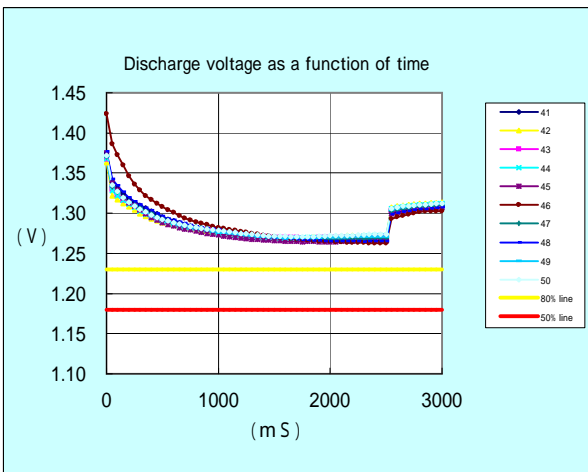
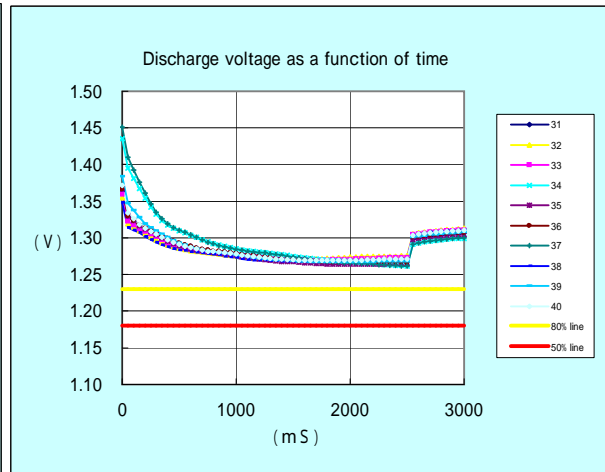
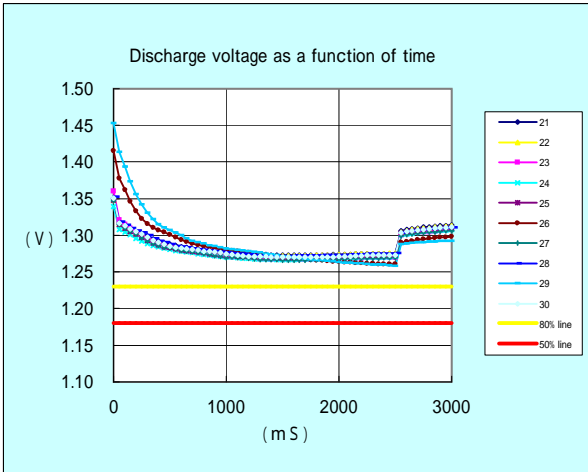
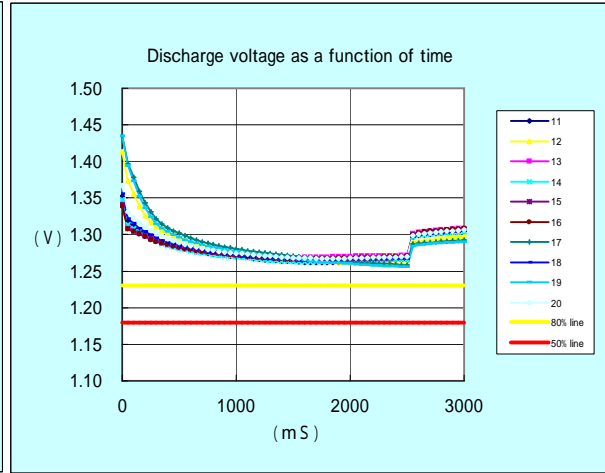
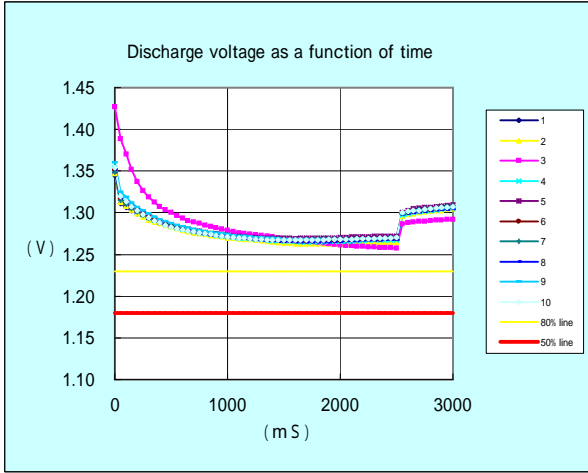


**** Company
Chiba Factory

Storage battery type
Manufacturing years
Discharge current

AHH40x80
1-Dec-95
40 A


Inspected day
15-Jun-10

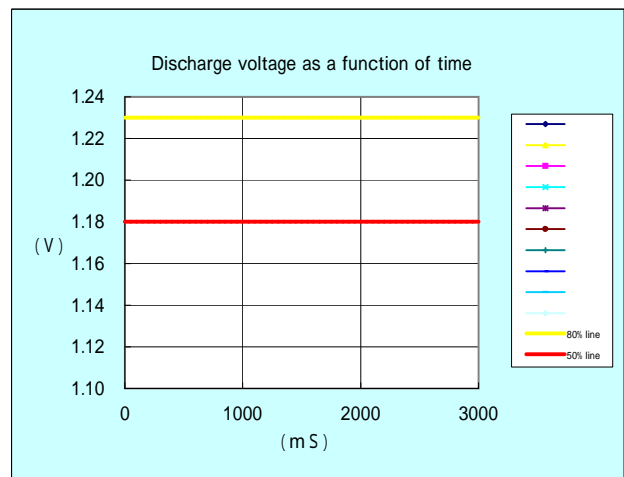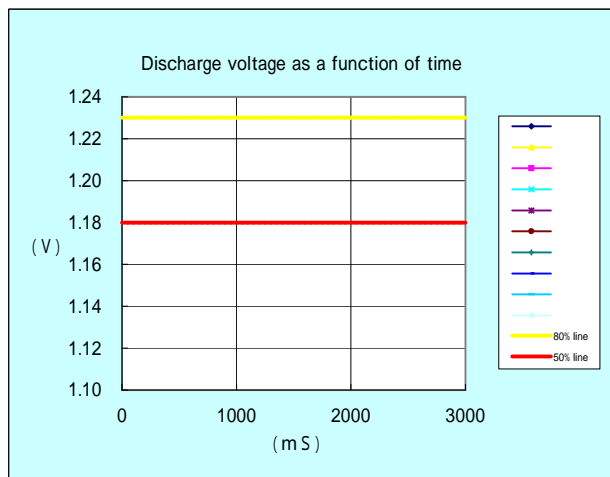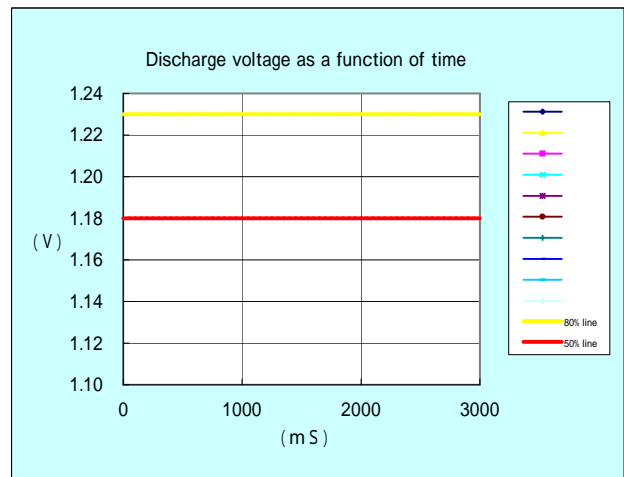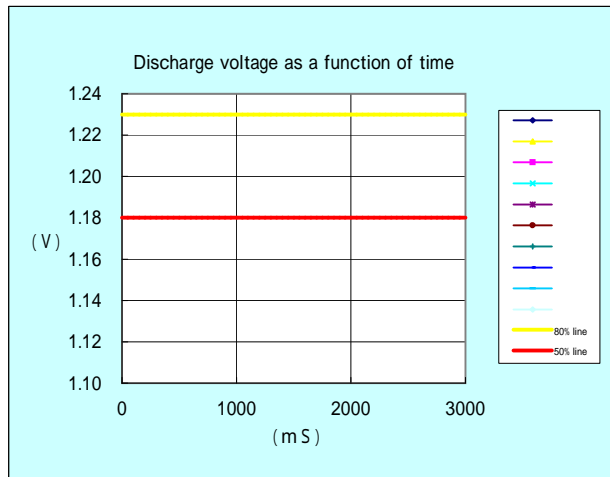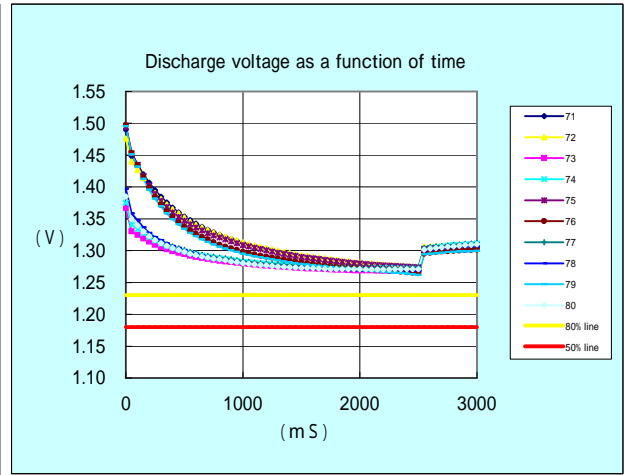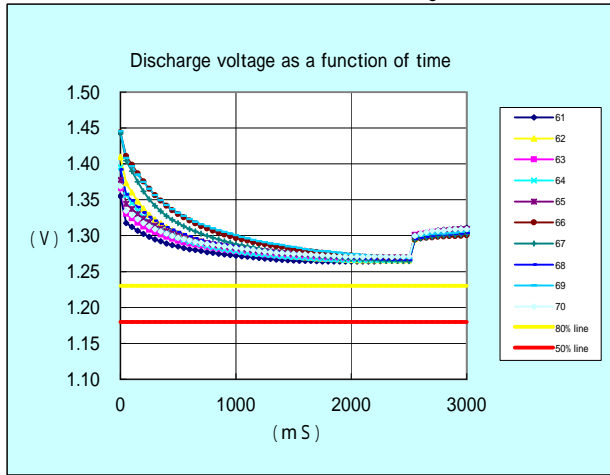

***** Company
Chiba Factory

Storage battery type AHH40x80
Manufacturing years 1-Dec-95
Discharge current 40 A

Inspected day 15-Jun-10

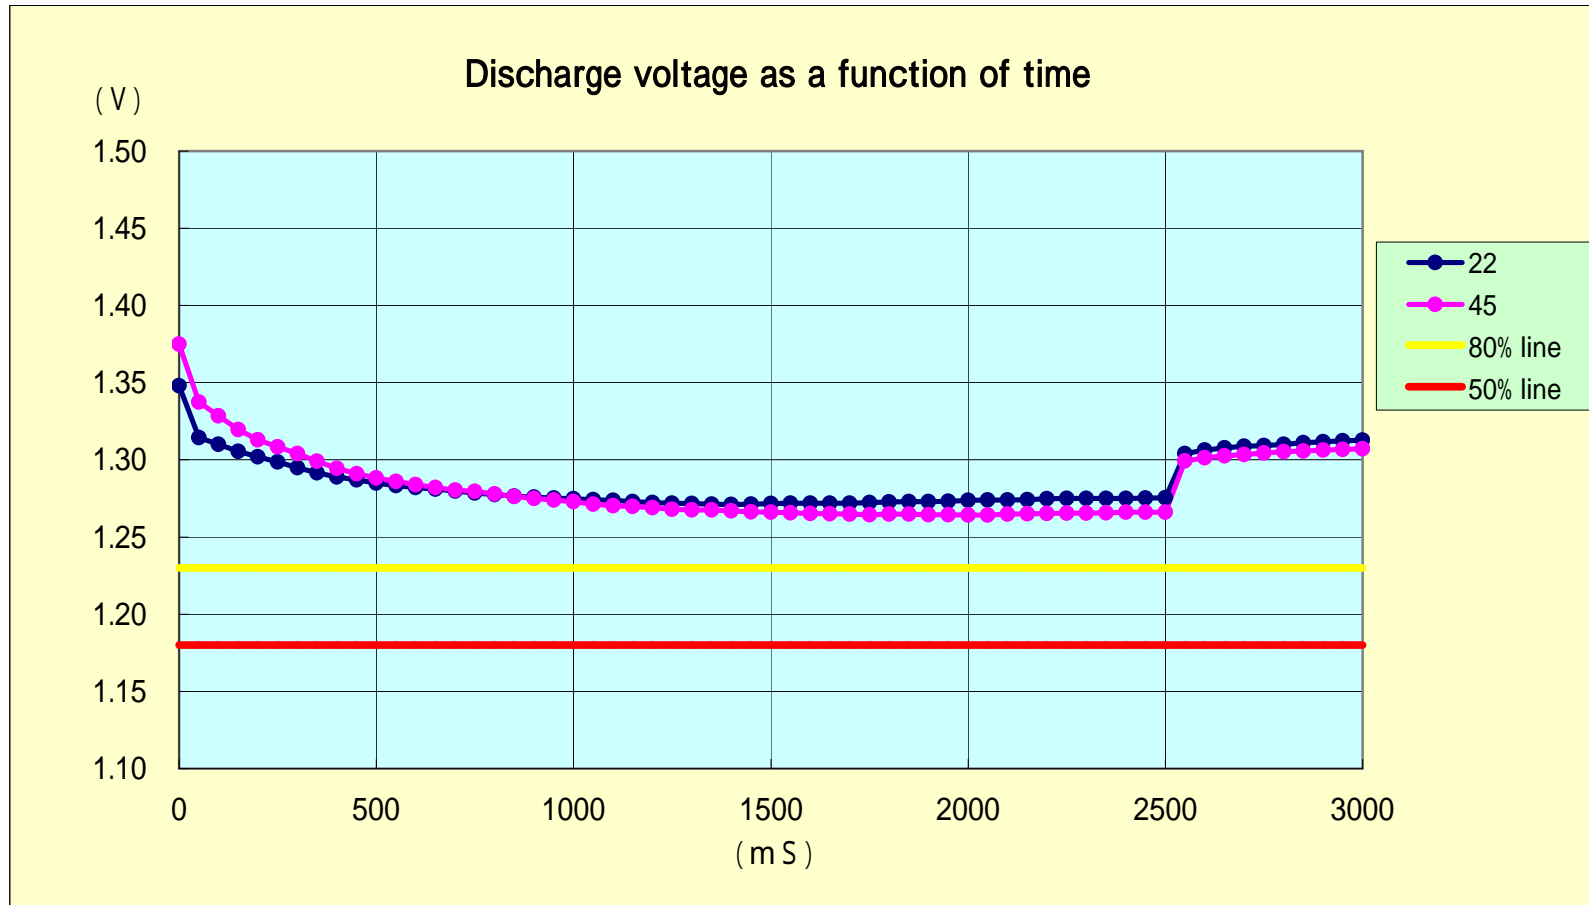

***** Company
Chiba Factory

Storage battery type AHH40x80
Manufacturing years 1-Dec-95
Customer name 40 A

Inspected day 15-Jun-10

